

TEV-Series - Valve Regulated Lead Acid Battery TEV12180

Data Sheet



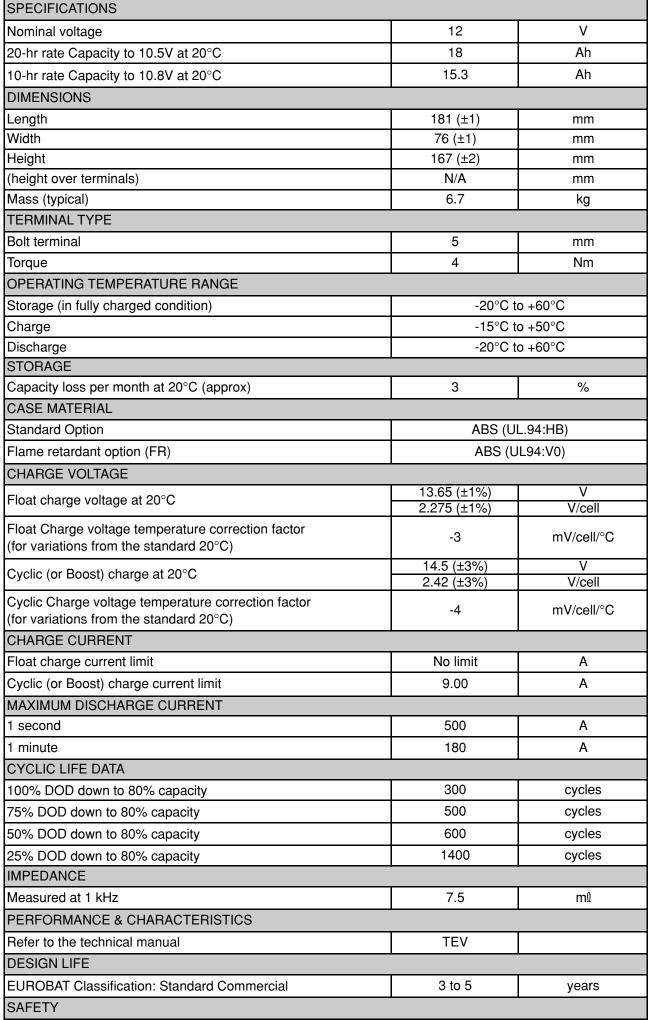

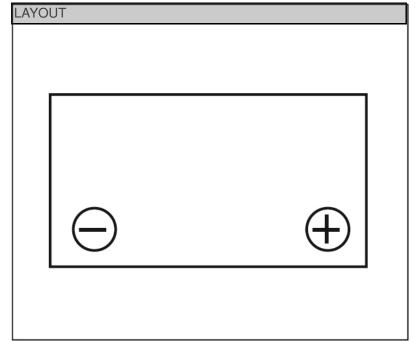

3RD PARTY CERTIFICATIONS

ISO 9001 - Quality Management Systems
ISO 14001 - Environmental Management Systems

EN 18001 - OHSAS Management Systems



UNDERWRITERS LABORATORIES Inc.

STANDARDS

IEC61056 IEC60895-21/22







ALL DATA IS SUBJECT TO CHANGE WITHOUT NOTICE Issue No.: V.1 / Issue Date: July 2010



Installation

Can be installed and operated in any orientation except permanently inverted

HandlesBatteries m

Batteries must not be suspended by their handles (where fitted)

Vent valves

Each cell is fitted with a low pressure release valve to allow gasses to escape and then reseal.

Gas Release

VRLA Batteries release hydrogen gas which can form explosive mixtures in air. Do not place inside a sealed container

Recycling

YUASA's VRLA batteries must be recycled at the end of life in accordance with local and national laws and regulations